



DEPARTMENT OF THE NAVY
COMMANDER, FLEET ACTIVITIES YOKOSUKA
PSC 473 BOX 1
FPO AP 96349

5090
Ser N00/906
13 Dec 23

From: Commander, Fleet Activities Yokosuka
To: Parents and Staff

Subj: DRINKING WATER LEAD SAMPLING RESULTS AT YOKOSUKA MIDDLE SCHOOL

Encl: (1) Sample Summary Results Table
(2) Floor Plan - Yokosuka Middle School

1. This notice is to make you aware of the latest developments regarding our efforts to address elevated lead levels in drinking water that were reported at Fleet Activities (FLEACT) Yokosuka Middle School.

2. On 18 January 2023, the community was made aware of the water testing of 261 outlets at Yokosuka Middle School. Of these, 16 outlets (9 hand washing sinks and 7 bubbler water fountains) initially tested higher than 15 parts per billion (ppb) screening level for lead. This is the Navy's designated level for action with additional testing and corrective measures.

3. All corrective measures were completed and levels at Yokosuka Middle School are now below the screening level of 15 ppb.

4. Specifically, the following corrective actions have been implemented after the initial findings:

a. All outlets and supply valves that tested above the 15 ppb were secured as the cause was investigated, resampled to confirm results, and permanent corrective action implemented.

b. Confirmation sampling was performed and results confirmed that bubbler water fountains in room 218, 223, 324, and 326 were below 15 ppb and no further action was required. We installed new bubbler water fountains and associated supply piping in room 123, 133, and 319. We conducted additional water sampling following these corrective measures, and results confirm that the water from these fountains is now below the screening level of 15 ppb for lead.

c. We conducted follow-up sampling of 9 faucets at hand washing sinks and confirmed the source of lead at 8 of the faucets (room 123, 222, 324, 144G, 147C, 147E, 225A, and 241A) was attributed to the faucet aerators. To correct this we removed and cleaned corroded aerators and resampled these locations. Resampling results confirm that lead levels are now below the screening level. To sustain this corrective action an aerator maintenance program will be implemented to replace and clean the aerator on a regular basis. One remaining faucet in 144J was permanently removed from service and the pipes were capped.

5. Enclosure (1) is a complete set of the test results, which includes the list of sampling locations and the purpose of the water outlet (drinking or washing). As described above, for those locations that exceeded the recommended screening level on the first test, we conducted a

Subj: DRINKING WATER LEAD SAMPLING RESULTS AT YOKOSUKA MIDDLE SCHOOL

follow-on resampling. Enclosure (I) provides details on which outlets required corrective action and the actions taken.

6. Enclosure (2) delineates locations where initial water sampling results exceeded 15 ppb.

7. For your information, included below are links to additional drinking water quality resources:

EPA (lead in drinking water in schools and day care centers)

<https://www.epa.gov/ground-water-and-drinking-water/3ts-reducing-lead-drinking-water>


Annual water quality report for the installation:

<https://cnrj.cnrc.navy.mil/Operations-and-Management/Water-Quality-Information/Water-quality-reports/#CFAY>

8. Please be assured that my team and I will continue to monitor and test water quality at FLEACT Yokosuka Middle School to ensure our drinking water complies with EPA regulations. If you have any questions or concerns regarding the LIPA Program, please contact the FLEA.CT Yokosuka Public Affairs Officer at: CFAYPublicAffairsOfficer@gmail.com.

9. If you have any health related questions or concerns about lead exposure, you are encouraged to contact your health care provider or if you are a TRICARE beneficiary use the Yokosuka Naval Hospital central appointment line at DSN: 315-243-5352. If unable to acquire information from previously discussed sources, please contact my staff immediately.

10. I am committed to the safety and health of all personnel and family members using our facilities and will keep you updated on this issue.



L. D. SOBOL

Copy to:
CNIC N45
NAVFAC, Director of Environmental Programs

Sample Summary Results Table
Priority Areas Lead Testing and Corrective Actions (October 2023)
FLEACT Yokosuka - Yokosuka Middle School
Buildings: 4272, 4373

Table 1. Summary of Results

SAMPLING LOCATION DESCRIPTION					INITIAL SAMPLING RESULTS			RE-SAMPLING RESULTS		CORRECTIVE ACTIONS	POST-CORRECTIVE ACTION SAMPLING RESULTS	
CATEGORY	SAMPLE ID	Room Number	Outlet Location	Outlet Description	Lead Screening Level of 15 ppb			Lead Screening Level of 15 ppb			Description	Recommended Level = 15 ppb
					First Draw (ppb)	Retest required?	Date Fixture Secured? (See Note 1)	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	First Draw (ppb) (See note 2)		Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)
SAMPLING DATE RESULTS DATE					2/17/2023 - 3/1/2023			3/25/2023	3/25/2023		6/23/2023	
					3/15/2023			3/31/2023	3/31/2023		7/5/2023	
DRINKING	YSK4372B069	147E	Classroom (wood shop)	Bubbler	3.3	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372B077	146F	Storage	Bubbler	3.4	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372B111	243	Classroom (Art Studio)	Bubbler	2.4	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372B112	243	Classroom (Art Studio)	Bubbler	4.1	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372B102	242	Home Economic Room	Bubbler	1.1	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372B093	238	Classroom (GPC)	Bubbler	7.7	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372B090	237	Classroom (GPC)	Bubbler	11	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C001-A	NA	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C001-B	NA	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C002-A	NA	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C002-B	NA	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C003-A	NA	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C003-B	NA	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C004	NA	Hallway	Cooler	0.6	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C005-A	NA	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C005-B	NA	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C006	NA	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C085	C202	Hallway	Cooler	0.65	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C086	C202	Hallway	Cooler	0.66	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C087-A	C202	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C087-B	C202	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C051-A	144A	Cafeteria	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C051-B	144A	Cafeteria	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C052-A	144A	Cafeteria	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C052-B	144A	Cafeteria	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C053	144A	Cafeteria	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C029	143A	Gym	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C030-A	143A	Gym	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C030-B	143A	Gym	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C031-A	143A	Gym	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4372C031-B	143A	Gym	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373C001	118	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373C002-A	118	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373C002-B	118	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373C003-A	118	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373C003-B	118	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373C004-A	118	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373C004-B	118	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373B005	122	Classroom (ESL)	Bubbler	0.94	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373B007	123	Classroom (General Purpose)	Bubbler	47	YES	3/16/2023	22	1.7	Outlet and supply components replaced with Lead free material	7.8	0.64
DRINKING	YSK4373B017	125	Classroom (General Purpose)	Bubbler	7.1	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373B019	126	Classroom (Talented & Gifted)	Bubbler	3.4	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373B020	126	Classroom (Talented & Gifted)	Bubbler	11	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373B041	130	Classroom (Communication Impaired)	Bubbler	5.6	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373B043	131	Classroom (General Purpose)	Bubbler	15	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373B045	132	Reading Improvement Spec	Bubbler	3.5	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373B047	133	Classroom (General Purpose)	Bubbler	17	YES	3/16/2023	34	3.1	Outlet and supply components replaced with Lead free material	5	0.71
DRINKING	YSK4373B057	135	Classroom (General Purpose)	Bubbler	3.9	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373B059	136	Classroom (General Purpose)	Bubbler	2.2	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373B061	137	Classroom (General Purpose)	Bubbler	2.1	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373C087-A	202	Hallway	Cooler	0.67	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373C087-B	202	Hallway	Cooler	0.72	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373C088-A	202	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373C088-B	202	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373C089-A	202	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373C089-B	202	Hallway	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373B090	209	Classroom (ESL)	Bubbler	3.1	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373B092	210	Classroom (General Purpose)	Bubbler	7.6	NO	N/A	N/A	N/A	N/A	N/A	N/A
DRINKING	YSK4373B102	212	Classroom (General Purpose)	Bubbler	5.1	NO	N/A	N/A	N/A	N/A	N/A	N/A

Sample Summary Results Table
Priority Areas Lead Testing and Corrective Actions (October 2023)
FLEACT Yokosuka - Yokosuka Middle School
Buildings: 4272, 4373

SAMPLING LOCATION DESCRIPTION					INITIAL SAMPLING RESULTS			RE-SAMPLING RESULTS			CORRECTIVE ACTIONS	POST-CORRECTIVE ACTION SAMPLING RESULTS	
					Lead Screening Level of 15 ppb			Lead Screening Level of 15 ppb				Description	
CATEGORY	SAMPLE ID	Room Number	Outlet Location	Outlet Description	First Draw (ppb)	Retest required?	Date Fixture Secured? (See Note 1)	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)		First Draw (ppb) (See note 2)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	
SAMPLING DATE					2/17/2023 - 3/1/2023			3/25/2023			6/23/2023		
RESULTS DATE					3/15/2023			3/31/2023			7/5/2023		
DRINKING	YSK4373B104	213	Classroom (General Purpose)	Bubbler	5.4	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B106	214	Classroom (General Purpose)	Bubbler	1.6	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B124	216	Classroom (General Purpose)	Bubbler	7.6	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B126	217	Classroom (Compensatory education)	Bubbler	5.4	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B128	218	Classroom (General Purpose)	Bubbler	50	YES	3/16/2023	3.7	2.9	No further action required	N/A	N/A	
DRINKING	YSK4373B130	219	Classroom (General Purpose)	Bubbler	8.1	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B132	220	Classroom (General Purpose)	Bubbler	1.3	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B134	221	Classroom (General Purpose)	Bubbler	6.1	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B136	222	Classroom (General Purpose)	Bubbler	2.5	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B138	223	Classroom (Learning Impaired)	Bubbler	18	YES	3/16/2023	15	2.8	No further action required	N/A	N/A	
DRINKING	YSK4373B140	224	Classroom (General Purpose)	Bubbler	2.5	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B150	226	Classroom (General Purpose)	Bubbler	2	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B164	309	Classroom (ESL)	Bubbler	4.3	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B166	310	Classroom (ESL)	Bubbler	3.4	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B176	312	Classroom (General Purpose)	Bubbler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B178	313	Classroom (General Purpose)	Bubbler	3.7	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B180	314	Classroom (General Purpose)	Bubbler	4.8	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B198	316	Classroom (General Purpose)	Bubbler	4.6	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B200	317	Classroom (General Purpose)	Bubbler	2.9	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B202	318	Classroom (General Purpose)	Bubbler	4.9	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B204	319	Classroom (General Purpose)	Bubbler	22	YES	3/16/2023	N/A	N/A	Outlet and supply components replaced with Lead free material	1.1	Not Detected	
DRINKING	YSK4373B206	320	Classroom (General Purpose)	Bubbler	8.3	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B208	321	Classroom (General Purpose)	Bubbler	3	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B210	322	Classroom (General Purpose)	Bubbler	10	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B212	323	Classroom (General Purpose)	Bubbler	5.2	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373B214	324	Classroom (General Purpose)	Bubbler	17	YES	3/16/2023	3.6	0.7	No further action required	N/A	N/A	
DRINKING	YSK4373B224	326	Classroom (General Purpose)	Bubbler	18	YES	3/16/2023	10	2	No further action required	N/A	N/A	
DRINKING	YSK4373C161-A	NA	Hallway (3rd FLR)	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373C161-B	NA	Hallway (3rd FLR)	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373C162-A	NA	Hallway (3rd FLR)	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373C162-B	NA	Hallway (3rd FLR)	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
DRINKING	YSK4373C163	NA	Hallway (3rd FLR)	Cooler	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
COOKING	YSK4372F103	242	Home Economic Room	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
COOKING	YSK4372F104	242	Home Economic Room	Faucet	4.2	NO	N/A	N/A	N/A	N/A	N/A	N/A	
COOKING	YSK4372F105	242	Home Economic Room	Faucet	6.4	NO	N/A	N/A	N/A	N/A	N/A	N/A	
COOKING	YSK4372F106	242	Home Economic Room	Faucet	3.9	NO	N/A	N/A	N/A	N/A	N/A	N/A	
COOKING	YSK4372F107	242	Home Economic Room	Faucet	13	NO	N/A	N/A	N/A	N/A	N/A	N/A	
COOKING	YSK4372F108	242	Home Economic Room	Faucet	9.8	NO	N/A	N/A	N/A	N/A	N/A	N/A	
COOKING	YSK4372F109	242	Home Economic Room	Faucet	15	NO	N/A	N/A	N/A	N/A	N/A	N/A	
COOKING	YSK4372F056	144C	Kitchen	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
COOKING	YSK4372F057	144C	Kitchen	Faucet	0.52	NO	N/A	N/A	N/A	N/A	N/A	N/A	
COOKING	YSK4372F058	144C	Kitchen	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
COOKING	YSK4372F059	144C	Kitchen	Faucet	2.7	NO	N/A	N/A	N/A	N/A	N/A	N/A	
COOKING	YSK4372F060	144C	Kitchen	Faucet	0.62	NO	N/A	N/A	N/A	N/A	N/A	N/A	
COOKING	YSK4372F062	144C	Kitchen	Faucet	0.91	NO	N/A	N/A	N/A	N/A	N/A	N/A	
COOKING	YSK4372F063	144C	Kitchen	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
COOKING	YSK4372F064	144C	Kitchen	Faucet	2.7	NO	N/A	N/A	N/A	N/A	N/A	N/A	
COOKING	YSK4372F065	144C	Kitchen	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
COOKING	YSK4372F088	235C	Kitchen	Faucet	0.92	NO	N/A	N/A	N/A	N/A	N/A	N/A	
COOKING	YSK4372F089	236C	Kitchen	Faucet	0.85	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F008	102	Men's Bathroom	Faucet	1.2	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F009	102	Men's Bathroom	Faucet	1.4	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F010	104	Women's Bathroom	Faucet	0.8	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F011	104	Women's Bathroom	Faucet	1.3	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F016	111	Boy's Bathroom	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F017	111	Boy's Bathroom	Faucet	1.1	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F018	111	Boy's Bathroom	Faucet	1.4	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F019	111	Boy's Bathroom	Faucet	2.1	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F020	113	Girl's Bathroom	Faucet	0.79	NO	N/A	N/A	N/A	N/A	N/A	N/A	

Sample Summary Results Table
Priority Areas Lead Testing and Corrective Actions (October 2023)
FLEACT Yokosuka - Yokosuka Middle School
Buildings: 4272, 4373

SAMPLING LOCATION DESCRIPTION					INITIAL SAMPLING RESULTS			RE-SAMPLING RESULTS		CORRECTIVE ACTIONS	POST-CORRECTIVE ACTION SAMPLING RESULTS		
					Lead Screening Level of 15 ppb			Lead Screening Level of 15 ppb			Recommended Level = 15 ppb		
CATEGORY	SAMPLE ID	Room Number	Outlet Location	Outlet Description	First Draw (ppb)	Retest required?	Date Fixture Secured? (See Note 1)	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	Description	First Draw (ppb) (See note 2)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	
SAMPLING DATE					2/17/2023 - 3/1/2023			3/25/2023				6/23/2023	
RESULTS DATE					3/15/2023			3/31/2023				7/5/2023	
WASHING	YSK4372F021	113	Girl's Bathroom	Faucet	0.74	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F022	113	Girl's Bathroom	Faucet	2	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F023	113	Girl's Bathroom	Faucet	0.61	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F026	148	Teacher's Office(Admin/Work Room)	Faucet	5	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F028	149	Cent Supply Room	Faucet	2.1	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F096	232	Girl's Bathroom	Faucet	1.1	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F097	232	Girl's Bathroom	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F098	233	Boy's Bathroom	Faucet	1.2	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F099	233	Boy's Bathroom	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F122	237	Classroom (GPC)	Faucet	0.66	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F094	238	Classroom (GPC)	Faucet	1.5	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F113	243	Classroom (Art Studio)	Faucet	2	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F114	243	Classroom (Art Studio)	Faucet	1.8	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F115	243	Classroom (Art Studio)	Faucet	2.8	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F116	243	Classroom (Art Studio)	Faucet	2	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F117	243	Classroom (Art Studio)	Faucet	2.1	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F118	243	Classroom (Art Studio)	Faucet	2.7	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F007	101L	Breakroom	Faucet	0.56	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F012	107A	Nurse's Office	Faucet	1	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F013	107B	Bathroom	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F014	109C	Teacher's Office	Faucet	1.7	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F025	114A	Teacher's Office	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F035	143C	Boy's Bathroom	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F036	143C	Boy's Bathroom	Faucet	1	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F042	143G	Girl's Bathroom	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F043	143G	Girl's Bathroom	Faucet	2.8	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F049	143M	Bathroom	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F066	144E	Bathroom	Faucet	3.3	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F055	144G	Room next to Stage	Faucet	33	YES	3/16/2023	8.9	2.1	Aerator maintenance	N/A	N/A	
WASHING	YSK4372F054	144J	Dressing Room	Faucet	28	YES	3/16/2023	21	1.5	Outlet removed from service. Cut and capped.	N/A	N/A	
WASHING	YSK4372F078	146F	Storage	Faucet	1.4	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F068	147B	Teacher's Office	Faucet	0.56	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F074	147C	Storage	Faucet	3.9	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F075	147C	Storage	Faucet	58	YES	3/16/2023	7.5	0.9	Aerator maintenance	N/A	N/A	
WASHING	YSK4372F076	147C	Storage	Faucet	8.9	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F070	147E	Classroom (Iwood shop)	Faucet	11	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F071	147E	Classroom (Iwood shop)	Faucet	5.9	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F072	147E	Classroom (Iwood shop)	Faucet	23	YES	3/16/2023	2.3	Not Detected	Aerator maintenance	N/A	N/A	
WASHING	YSK4372F027	148A	Teacher's Office(Admin/Work Room)	Faucet	2.3	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F092	239A	Storage	Faucet	8	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F100	240A	Storage	Faucet	1.2	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F101	241A	Storage	Faucet	58	YES	3/16/2023	1.9	Not Detected	Aerator maintenance	N/A	N/A	
WASHING	YSK4372F119	NA	Patio	Faucet	1.3	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F120	NA	Patio	Faucet	3.7	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4372F121	NA	Patio	Faucet	2.5	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F006	122	Classroom (ESL)	Faucet	2.1	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F008	123	Classroom (General Purpose)	Faucet	24	YES	3/16/2023	4.8	0.6	Aerator maintenance	N/A	N/A	
WASHING	YSK4373F016	124A	Lab Prep Room	Faucet	2.8	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F018	125	Classroom (General Purpose)	Faucet	1.5	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F021	126	Classroom (Talented & Gifted)	Faucet	4.5	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F022	126	Classroom (Talented & Gifted)	Faucet	2	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F024	127	Classroom (Learning Impaired)	Faucet	2.2	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F025	119	Boy's toilet	Faucet	1.7	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F026	119	Boy's toilet	Faucet	1.1	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F027	121	Girl's toilet	Faucet	0.87	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F028	121	Girl's toilet	Faucet	0.75	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F029	121	Girl's toilet	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F038	128A	Lab Prep Room	Faucet	2.1	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F040	129	Classroom (General Purpose)	Faucet	1.7	NO	N/A	N/A	N/A	N/A	N/A	N/A	

Sample Summary Results Table
Priority Areas Lead Testing and Corrective Actions (October 2023)
FLEACT Yokosuka - Yokosuka Middle School
Buildings: 4272, 4373

SAMPLING LOCATION DESCRIPTION					INITIAL SAMPLING RESULTS			RE-SAMPLING RESULTS		CORRECTIVE ACTIONS	POST-CORRECTIVE ACTION SAMPLING RESULTS		
					Lead Screening Level of 15 ppb			Lead Screening Level of 15 ppb			Recommended Level = 15 ppb		
CATEGORY	SAMPLE ID	Room Number	Outlet Location	Outlet Description	First Draw (ppb)	Retest required?	Date Fixture Secured? (See Note 1)	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	Description	First Draw (ppb) (See note 2)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	
SAMPLING DATE					2/17/2023 - 3/1/2023			3/25/2023				6/23/2023	
RESULTS DATE					3/15/2023			3/15/2023				7/5/2023	
WASHING	YSK4373F042	130	Classroom (Communication Impaired)	Faucet	2	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F044	131	Classroom (General Purpose)	Faucet	2.3	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F046	132	Reading Improvement Spec	Faucet	1.3	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F048	133	Classroom (General Purpose)	Faucet	1.4	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F056	134A	Lab Prep Room	Faucet	3.6	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F058	135	Classroom (General Purpose)	Faucet	1	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F060	136	Classroom (Learning Impaired)	Faucet	14	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F062	137	Classroom (General Purpose)	Faucet	1.2	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F070	138A	Lab Prep Room	Faucet	4.4	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F072	139	Classroom (General Purpose)	Faucet	2.8	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F073	140	Boy's toilet	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F074	140	Boy's toilet	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F075	140	Boy's toilet	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F076	140	Boy's toilet	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F077	142	Girl's toilet	Faucet	0.67	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F078	142	Girl's toilet	Faucet	0.53	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F079	142	Girl's toilet	Faucet	0.5	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F080	142	Girl's toilet	Faucet	1.8	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F091	209	Classroom (ESL)	Faucet	2.1	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F093	210	Classroom (General Purpose)	Faucet	1.2	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F101	211A	Lab Prep Room	Faucet	2.5	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F103	212	Classroom (General Purpose)	Faucet	3	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F105	213	Classroom (General Purpose)	Faucet	4.6	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F107	214	Classroom (General Purpose)	Faucet	2.8	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F108	207	Boy's toilet	Faucet	0.69	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F109	207	Boy's toilet	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F110	206	Girl's toilet	Faucet	0.87	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F111	206	Girl's toilet	Faucet	1.4	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F112	206	Girl's toilet	Faucet	0.93	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F114	204	Men's toilet	Faucet	1.2	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F115	205	Women's toilet	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F123	215A	Lab Prep Room	Faucet	3.9	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F125	216	Classroom (General Purpose)	Faucet	4.6	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F127	217	Classroom (Compensatory education)	Faucet	1.2	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F129	218	Classroom (General Purpose)	Faucet	2.4	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F131	219	Classroom (General Purpose)	Faucet	0.59	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F133	220	Classroom (General Purpose)	Faucet	1.3	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F135	221	Classroom (General Purpose)	Faucet	1.5	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F137	222	Classroom (General Purpose)	Faucet	31	YES	3/16/2023	1.8	Not Detected	Aerator maintenance	N/A	N/A	
WASHING	YSK4373F139	223	Classroom (Learning Impaired)	Faucet	3.3	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F141	224	Classroom (General Purpose)	Faucet	1.3	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F149	225A	Lab Prep Room	Faucet	27	YES	3/16/2023	6.6	0.8	Aerator maintenance	N/A	N/A	
WASHING	YSK4373F151	226	Classroom (General Purpose)	Faucet	1.8	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F152	227	Boy's toilet	Faucet	0.75	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F153	227	Boy's toilet	Faucet	1	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F154	227	Boy's toilet	Faucet	0.75	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F155	227	Boy's toilet	Faucet	0.79	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F156	228	Girl's toilet	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F157	228	Girl's toilet	Faucet	0.5	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F158	228	Girl's toilet	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F159	228	Girl's toilet	Faucet	1.8	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F165	309	Classroom (ESL)	Faucet	4.9	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F167	310	Classroom (ESL)	Faucet	4.5	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F175	311A	Lab Prep Room	Faucet	3.7	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F177	312	Classroom (General Purpose)	Faucet	1.3	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F179	313	Classroom (General Purpose)	Faucet	2.3	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F181	314	Classroom (General Purpose)	Faucet	1.6	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F182	307	Boy's toilet	Faucet	0.79	NO	N/A	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F183	307	Boy's toilet	Faucet	Not Detected	NO	N/A	N/A	N/A	N/A	N/A	N/A	

Sample Summary Results Table
Priority Areas Lead Testing and Corrective Actions (October 2023)
FLEACT Yokosuka - Yokosuka Middle School
Buildings: 4272, 4373

SAMPLING LOCATION DESCRIPTION					INITIAL SAMPLING RESULTS			RE-SAMPLING RESULTS		CORRECTIVE ACTIONS	POST-CORRECTIVE ACTION SAMPLING RESULTS	
CATEGORY	SAMPLE ID	Room Number	Outlet Location	Outlet Description	Lead Screening Level of 15 ppb			Lead Screening Level of 15 ppb			Description	Recommended Level = 15 ppb
					First Draw (ppb)	Retest required?	Date Fixture Secured? (See Note 1)	First Draw (ppb)	Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)	First Draw (ppb) (See note 2)		Follow up Flush - Collected 30 seconds after First Draw Sampling (ppb)
SAMPLING DATE					2/17/2023 - 3/1/2023			3/25/2023		6/23/2023		
RESULTS DATE					3/15/2023			3/31/2023		7/5/2023		
WASHING	YSK4373F184	306	Girl's toilet	Faucet	1	NO	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F185	306	Girl's toilet	Faucet	0.89	NO	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F186	306	Girl's toilet	Faucet	1.3	NO	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F188	304	Men's toilet	Faucet	1.1	NO	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F189	305	Women's toilet	Faucet	0.7	NO	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F197	315A	Lab Prep Room	Faucet	6.4	NO	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F199	316	Classroom (General Purpose)	Faucet	2.1	NO	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F201	317	Classroom (General Purpose)	Faucet	6.1	NO	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F203	318	Classroom (General Purpose)	Faucet	4.5	NO	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F205	319	Classroom (General Purpose)	Faucet	1.9	NO	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F207	320	Classroom (General Purpose)	Faucet	4.9	NO	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F209	321	Classroom (General Purpose)	Faucet	3.6	NO	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F211	322	Classroom (General Purpose)	Faucet	1.2	NO	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F213	323	Classroom (General Purpose)	Faucet	3.5	NO	N/A	N/A	N/A	N/A	N/A	
WASHING	YSK4373F215	324	Classroom (General Purpose)	Faucet	23	YES	3/16/2023	1.9	Not Detected	Aerator maintenance	N/A	

Notes:
 1 Affected outlets were immediately secured after receiving communication from the lab on results exceeding the recommended level of 15 ppb.

Table 2. Summary Statistics

CATEGORY	INITIAL SAMPLING RESULTS	RE-SAMPLING RESULTS			POST-CORRECTIVE ACTION RESULTS
	Lead Screening Level of 15 ppb				
	First Draw (ppb)	Water Fountain	First Draw (ppb)	Follow up Flush	First Draw (ppb)
Total Drinking	91	0	6	6	3
Total Drinking > 15 ppb	7	0	2	0	0
Total Cooking	18	0	0	0	0
Total Cooking > 15 ppb	0	0	0	0	0
Total Washing	152	0	9	9	0
Total Washing > 15 ppb	9	0	1	0	0
Total Samples	261	0	15	15	3
Total Samples > 15 ppb	16	0	3	0	0

Floor Plan - Yokosuka Middle School

Bldg. 4372, 4373, 4375

F = Faucet

C = Cooler water fountain

B = Bubbler water fountain


No Sampling at the following:

S = Shower

J = Janitor sink

HB = Hose Bibb

L = Lab Sink

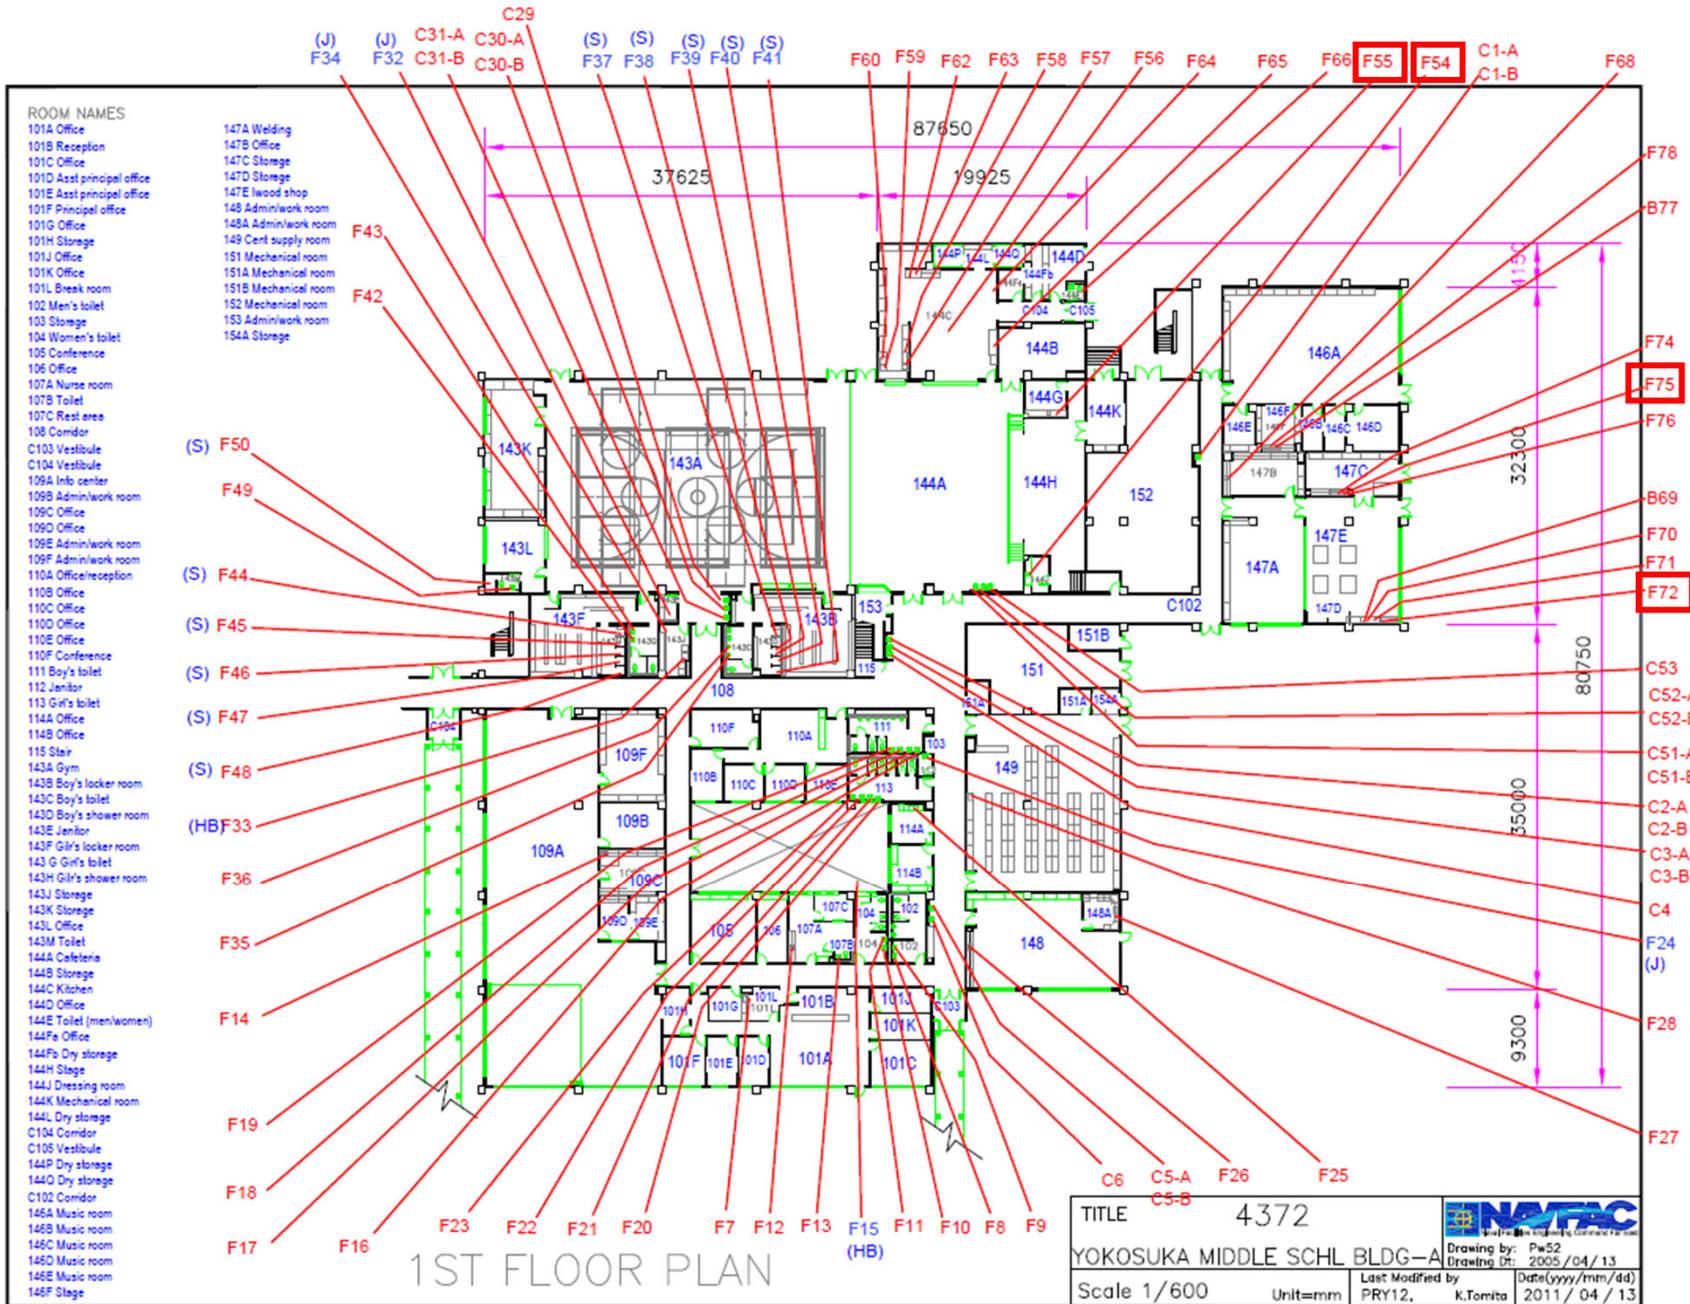


NAMES

e
ption
e
principal office
principal office
principal office
e
e
k room
toilet
je
in's toilet
rence

147A Welding
147B Office
147C Storage
147D Storage
147E Wood shop
148 Admin/work room
148A Admin/work room
149 Cent supply room
151 Mechanical room
151A Mechanical room
151B Mechanical room
152 Mechanical room
153 Admin/work room
154A Storage

ie room
it
i area
or
ibule
ibule
center
in/work room
ie
in/work room
in/work room
el/reception
e
ie
ie
e
erence
toilet
r
toilet
e
e

s locker room
s toilet
s shower room
lor
i locker room
s toilet
s shower room
ige
ige
e
st
lerie
tge
ten
ie
d (men/women)
oe
storage
e
sing room
hanical room
storage
idor
ibule
storage
storage
idor
ic room
ic room

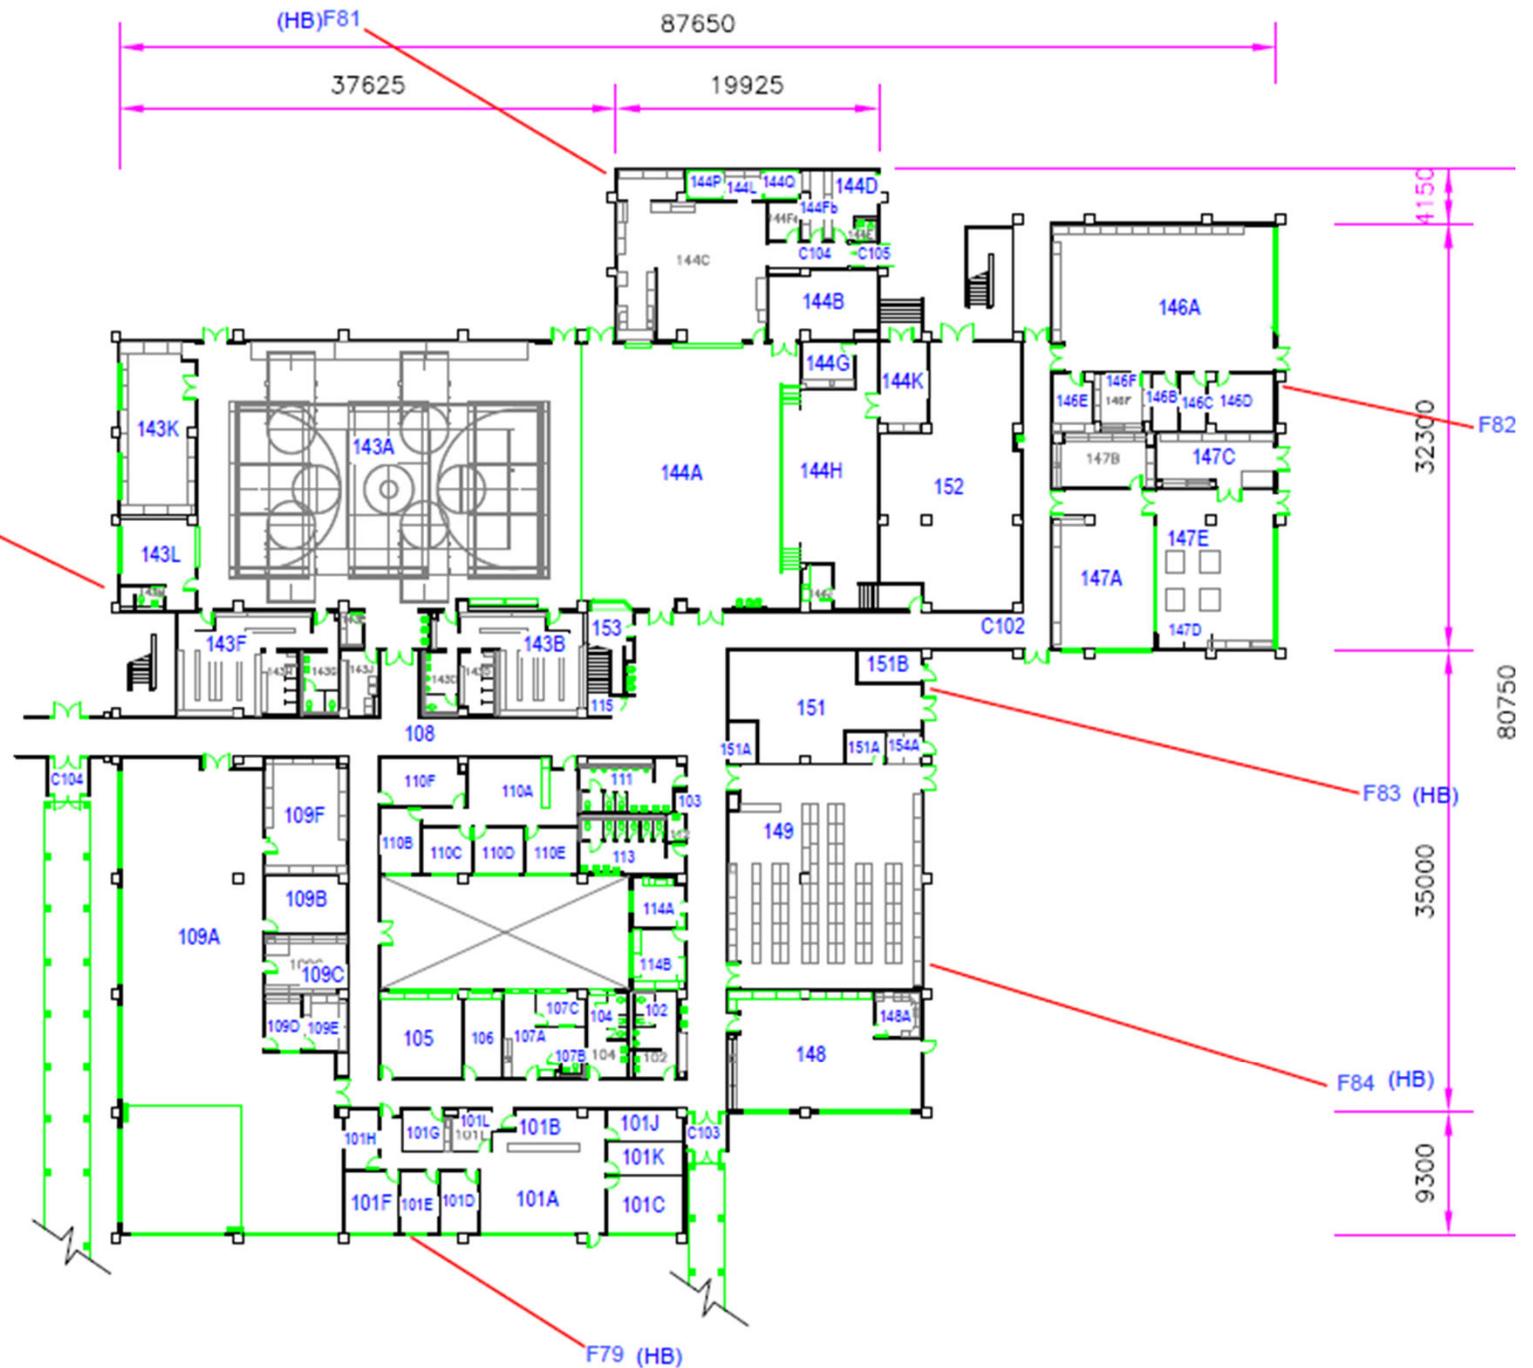

Outdoor

TITLE 4372




Enclosure (2)

BLDG 4373 1F

ROOM NAMES

- | | | |
|------------------------------------|----------------------------------|----------------------------------|
| 116 Stair (2) | 127A Office | 136 Learning impaired (mild/mod) |
| 117 Elevator | 128 Science Lab | 136A Office |
| 118 Corridor | 128A Lab prep room | 137 General purpose classroom(6) |
| 119 Boy's Toilet | 129 General purpose classroom(6) | 138 Science lab |
| 120 Janitor | 130 Communication impaired | 138A Lab prep room |
| 121 Girl's Toilet | 130A Office | 139 General purpose classroom(6) |
| 122 English as a second language | 131 General purpose classroom(6) | 140 Boy's toilet |
| 123 General purpose classroom(6) | 132 Reading improvement spec | 141 Janitor |
| 124 Science Lab | 132A Office | 142 Girl's toilet |
| 124A Lab prep room | 133 General purpose classroom(6) | 150 MECH room |
| 125 General purpose classroom(6) | 134 Science Lab | 150A Telecom room |
| 126 Talented & Gifted | 134A Lab prep room | 150B Storage |
| 127 Learning impaired (MDD/Severe) | 135 General purpose classroom(6) | 150B Storage |

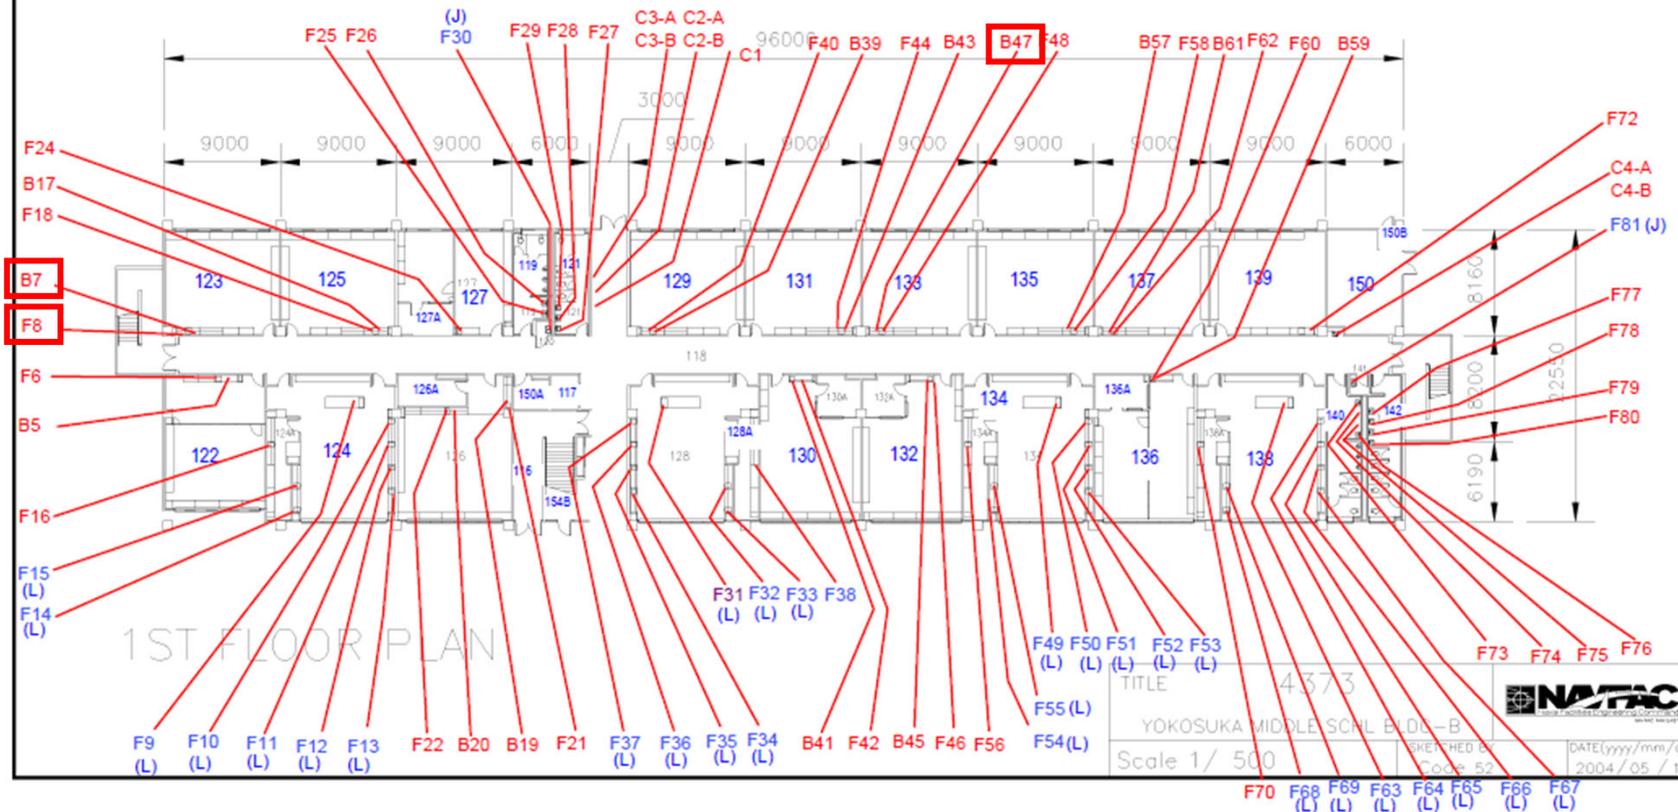


BLDG 4373 2F

B: Bubbler
F: Faucet
C: Cooler

ROOM NAMES

- | | | |
|----------------------------------|----------------------------------|----------------------------------|
| 201 Stair(2) | 212 General purpose classroom(7) | 222 General purpose classroom(7) |
| 202 Corridor | 213 General purpose classroom(7) | 223 Learning impaired (mild/mod) |
| 203 Elevator | 214 General purpose classroom(7) | 223A Office |
| 204 Men's toilet | 215 Science Lab | 224 General purpose classroom(7) |
| 205 Women's toilet | 215A Lab prep room | 225 Science Lab |
| 206 Girl's toilet | 216 General purpose classroom(7) | 225A Lab prep room |
| 207 Boy's toilet | 217 Compensatory education | 226 General purpose classroom(7) |
| 208 Janitor | 217A Office | 227 Boy's toilet |
| 209 English as a second language | 218 General purpose classroom(7) | 228 Girl's toilet |
| 210 General purpose classroom(7) | 219 General purpose classroom(7) | 229 Janitor |
| 211 Science Lab | 220 General purpose classroom(7) | 244 MECH room |
| 211A Lab prep room | 221 General purpose classroom(7) | 244A Telecom workroom |

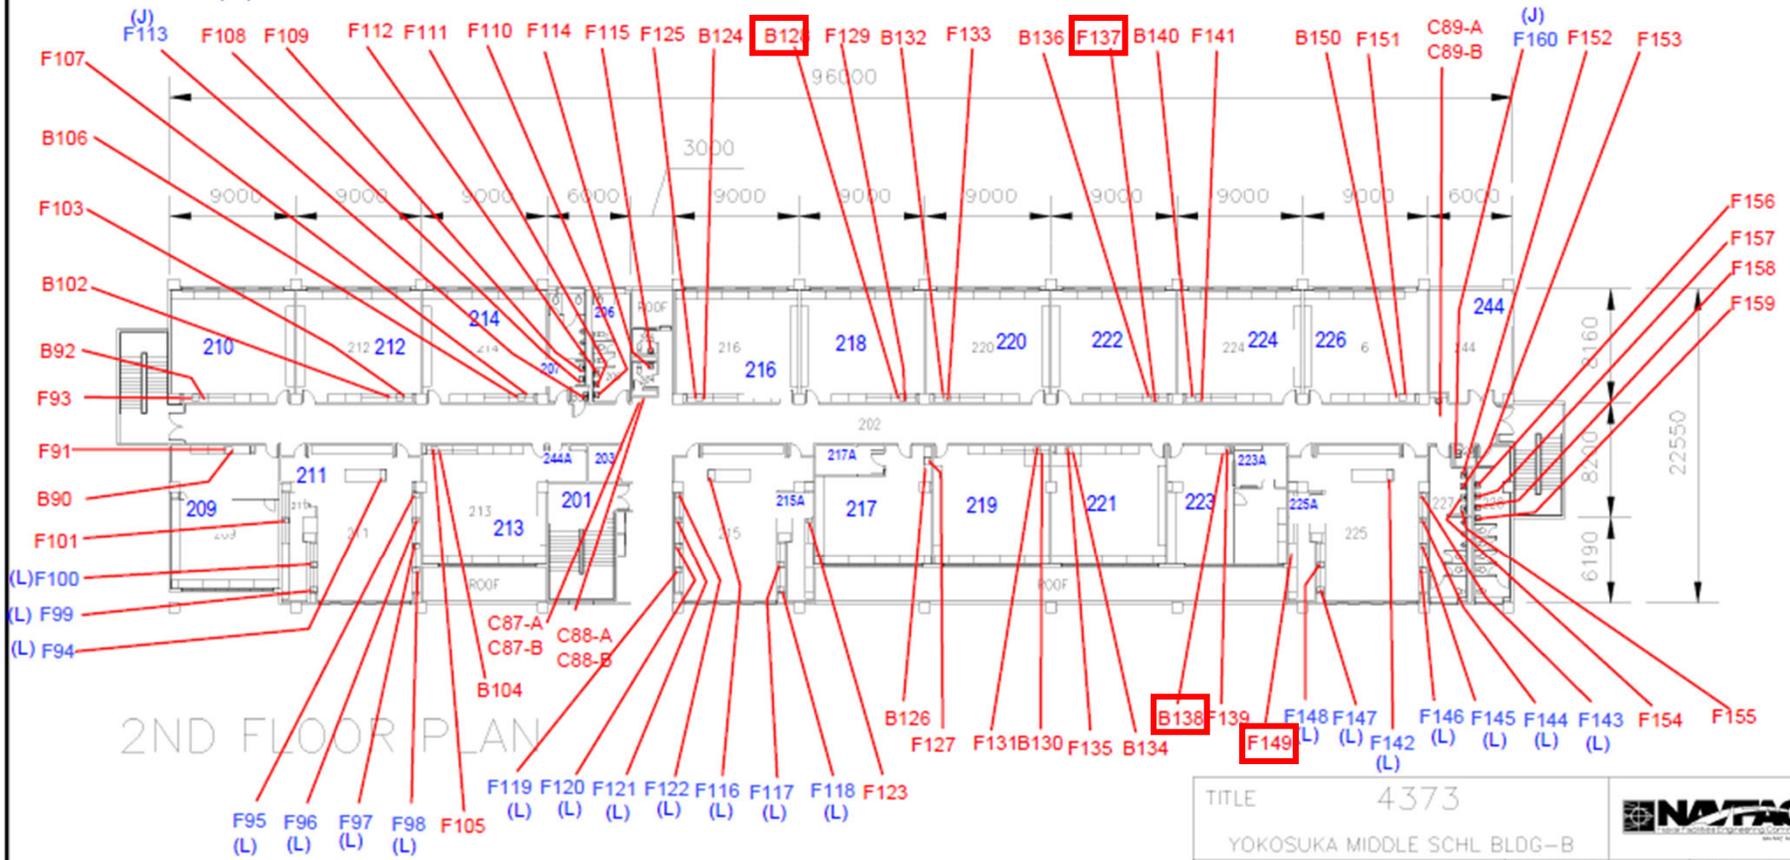

2ND FLOOR PLAN

TITLE	4373	
YOKOSUKA MIDDLE SCHL BLDG-B		
Scale	1/ 500	SKETCHED BY Code 52
		DATE(yyyy/mm/d) 2004/05/12

BLDG 4373 3F


B: Bubbler
F: Faucet
C: Cooler

ROOM NAMES

301 STAIR(2)
302 CORRIDOR
303 ELEVATOR
304 MEN'S TOILET
305 WOMEN'S TOILET
306 GIRL'S TOILET
307 BOY'S TOILET
308 JANITOR
309 ENGLISH AS A SECOND LANGUAGE
310 GENERAL PURPOSE CLASSROOM(8)
311 SCIENCE LABORATORY
311A LABORATORY PREP ROOM

312 General purpose classroom(8)
313 General purpose classroom(8)
314 General purpose classroom(8)
315 Science Lab
315A Lab prep room
316 General purpose classroom(8)
317 Compensatory education
317A Office
318 General purpose classroom(8)
319 General purpose classroom(8)
320 General purpose classroom(8)
321 General purpose classroom(8)

322 General purpose classroom(8)
323 Emotionally impaired
323A Office
324 General purpose classroom(8)
325 Science Lab
325A Lab prep room
326 General purpose classroom(8)
327 Boy's toilet
328 Girl's toilet
329 Janitor
330 MECH room
330A Telecom workroom

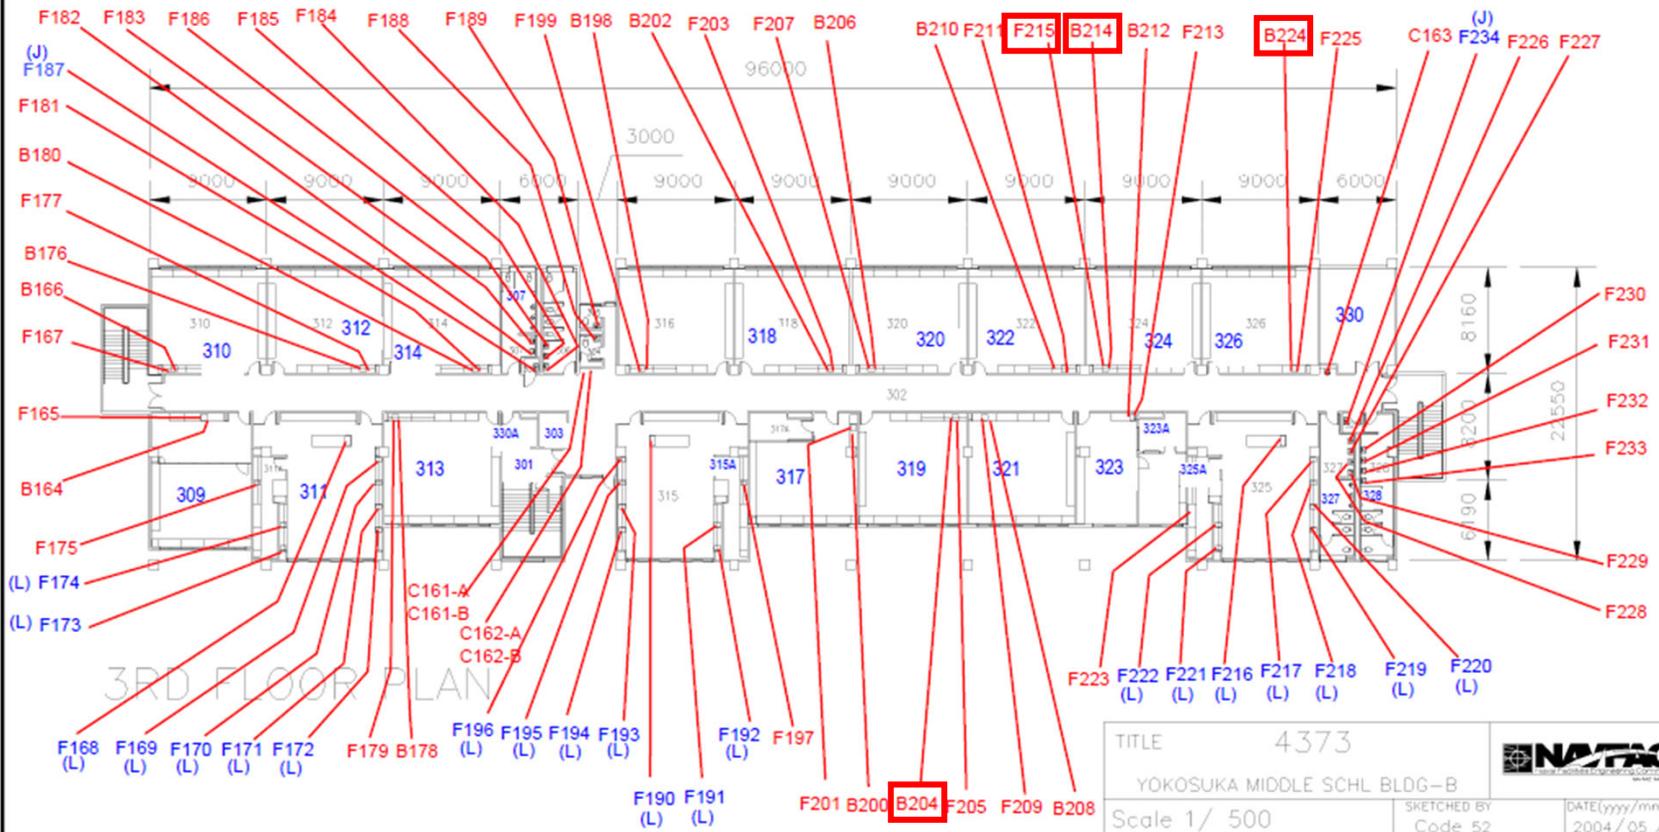

BLDG 4373 OUTDOOR

B: Bubbler
F: Faucet
C: Cooler

ROOM NAMES

- 116 Stair (2)
- 117 Elevator
- 118 Corridor
- 119 Boy's Toilet
- 120 Janitor
- 121 Girl's Toilet
- 122 English as a second language
- 123 General purpose classroom(6)
- 124 Science Lab
- 124A Lab prep room
- 125 General purpose classroom(6)
- 126 Talented & Gifted
- 127 Learning impaired (MDD/Severe)


- 127A Office
- 128 Science Lab
- 128A Lab prep room
- 129 General purpose classroom(6)
- 130 Communication impaired
- 130A Office
- 131 General purpose classroom(6)
- 132 Reading improvement spec
- 132A Office
- 133 General purpose classroom(6)
- 134 Science Lab
- 134A Lab prep room
- 135 General purpose classroom(6)

- 136 Learning impaired (mild/mod)
- 136A Office
- 137 General purpose classroom(6)
- 138 Science lab
- 138A Lab prep room
- 139 General purpose classroom(6)
- 140 Boy's toilet
- 141 Janitor
- 142 Girl's toilet
- 150 MECH room
- 150A Telecom room
- 150B Storage
- 150B Storage



1ST FLOOR PLAN

TITLE	4373	
YOKOSUKA MIDDLE SCHL BLDG-B		
Scale 1/ 500	SKETCHED BY Code 52	DATE/yyyy/mm/04 2004/05/12

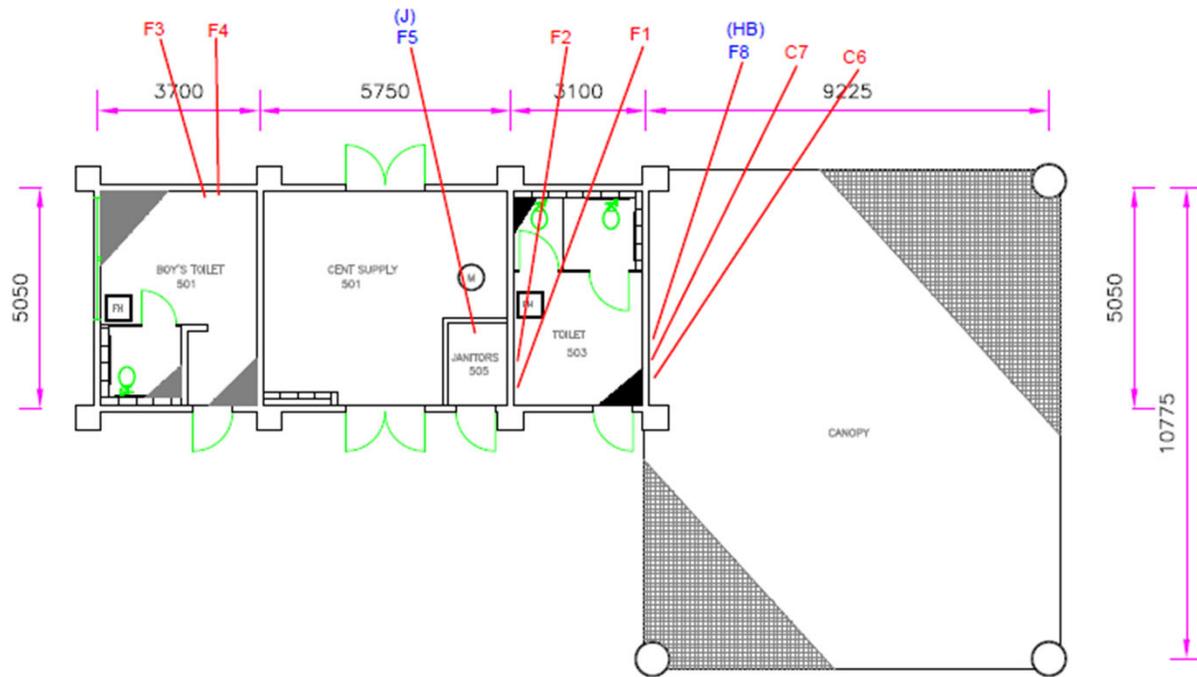

1ST FLOOR PLAN

TITLE	4375		
PAVILION, YOKOSUKA MDL SCHL		Drawing by:	Pw52
Scale 1/150		Drawing Dt:	2004/04/09
Unit=mm	Last Modified by	Date(yyyy/mm/dd)	
	PRY12.	K.Tomita	2011/09/07

